

Todd County Holding Tank Design Form

Property Owner(s) _____ Phone Number _____

Address _____

P.I.D. _____ Section _____ Township _____ N Range _____ W

Date _____ Time _____ Weather conditions _____

Location Information shoreland dwelling replacement system
(check all that apply) protection area other establishment new home construction

Homeowner Information

No. of bedrooms _____ bedrooms (includes possible additions)

No. of residents in home adults children

Estimated flow _____ gpd*


Well casing depth _____ feet

Other Requirements** Variance Administrative Variance
 Holding Tank Agreement Greywater System Certification

Designers Signature _____ License # _____ Phone # _____

* All holding tanks shall have a minimum capacity of 1500 gallons and, if feasible, have multiple compartments for the purpose of installing a lift pump if a drainfield area becomes available.
** Holding tanks are an alternative system for use only when site location/size does not allow enough room for a drainfield.

Site Plan

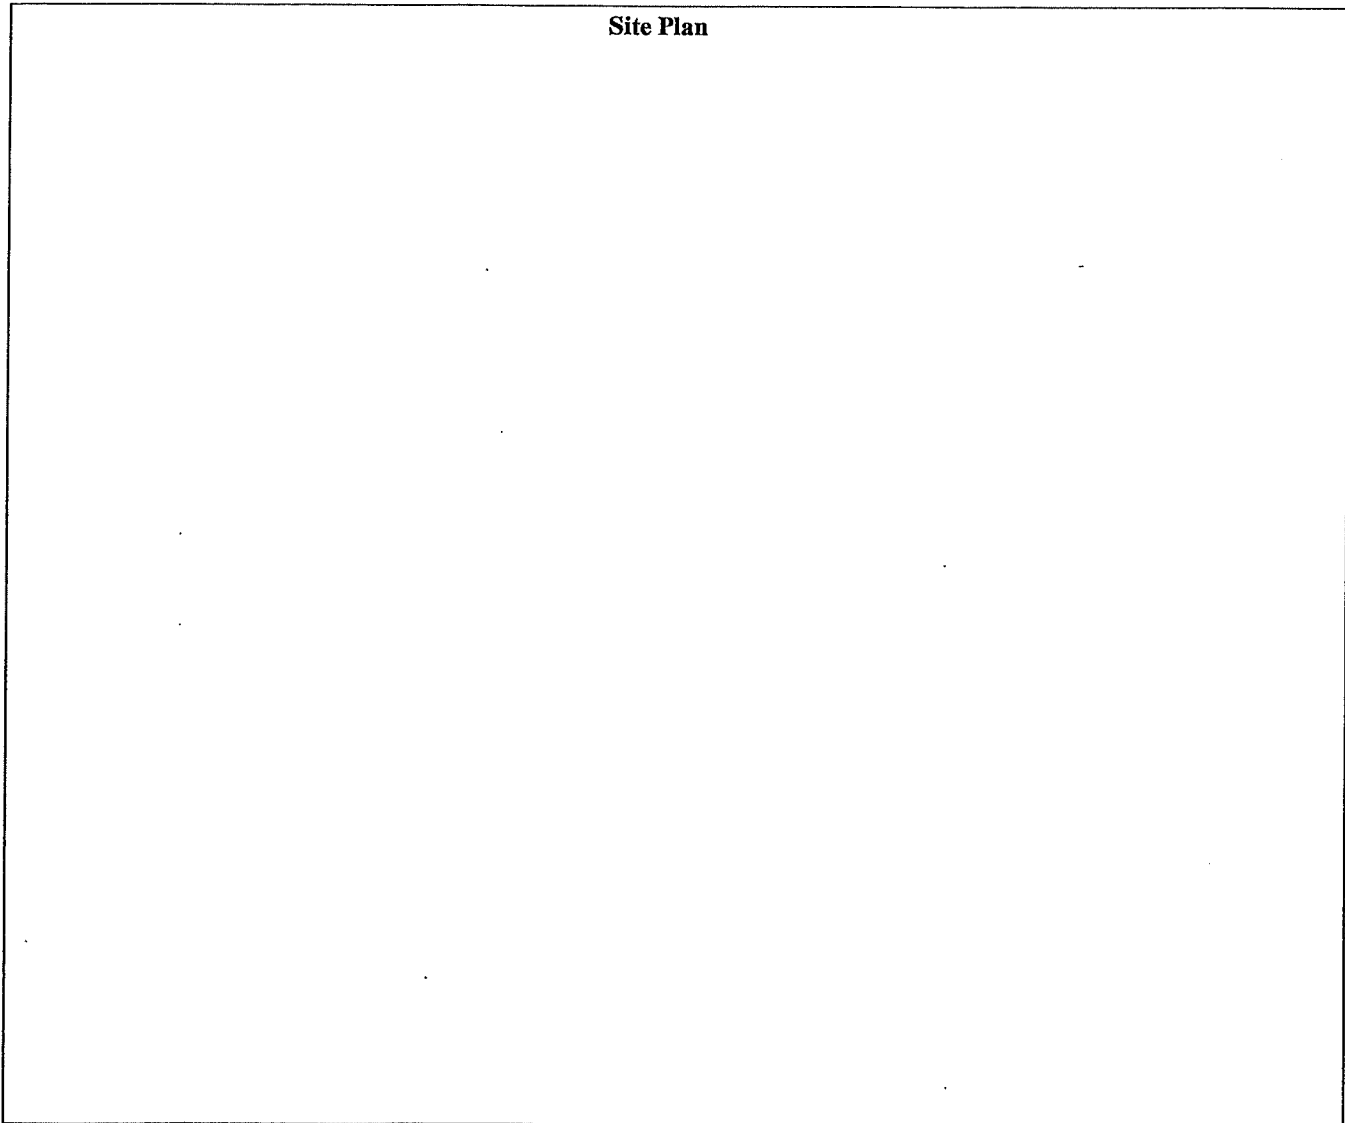

Note: Include existing and proposed buildings, easements, property lines, lot dimensions, applicable setbacks, direction, and assess route for tank maintenance.

Residential Holding Tank Pumping and Disposal Service Agreement

Property Owner

Name _____

Site Address _____

Parcel # _____

Septic Tank Maintainer

Business Name _____

Address _____

License # _____

We, the undersigned, enter into this holding tank pumping and disposal service agreement. The owner agrees to properly monitor the tank level and schedule required pumping and disposal services. The owner agrees to notify _____ (maintainer) when tank level reaches $\frac{3}{4}$ full or alarm signals pumping is required.

Contractor agrees to provide pumping and disposal services according to the regular servicing schedule or as needed to prevent discharge. Homeowner shall compensate Maintainer as agreed by the parties for all services rendered.

Maintainer Signature

Date

Owner Signature

Date